TOWN OF FRAMINGHAM
DEPARTMENT OF PUBLIC WORKS

# TRENCH DETAIL FOR COMMUNICATIONS CONDUIT

DATE: MARCH 2013
REV: 0

DETAIL NO. R-5.8.0

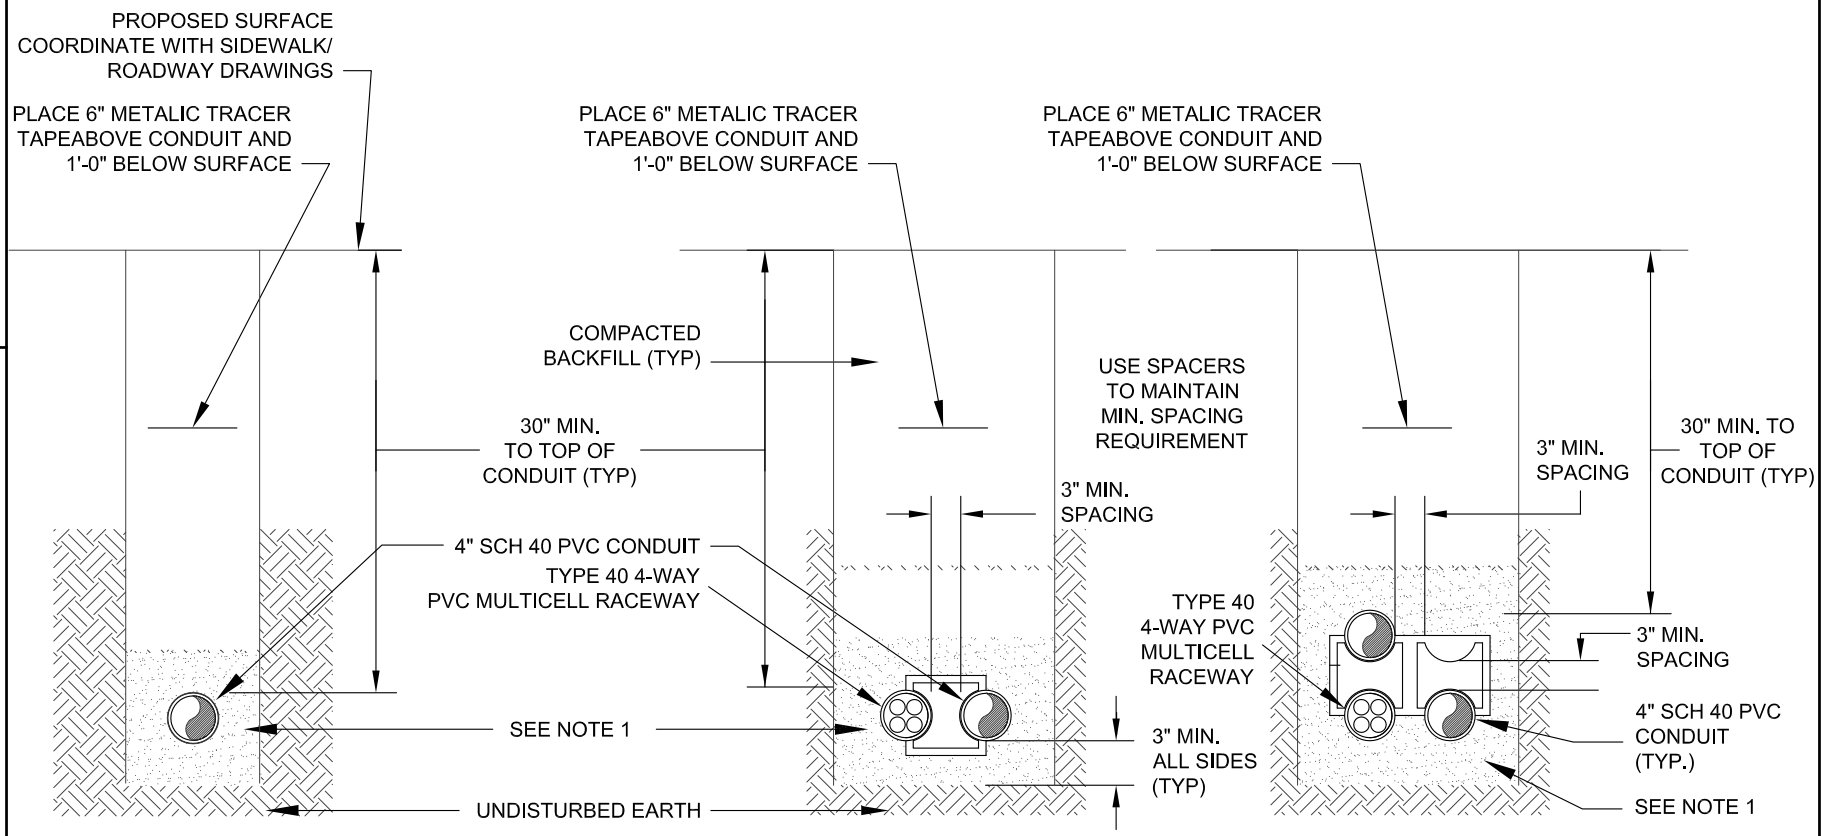


CONCRETE ENCASED (1X1 CONFIGURATION)

CONCRETE ENCASED (1X2 CONFIGURATION)

CONCRETE ENCASED (1X1 OR 1X2 CONFIGURATION OVER 1X2 CONFIGURATION)

NOTE:

1. CONDUIT TO BE ENCASED IN CEMENT CONCRETE WITH 3" MINIMUM COVER ON ALL SIDES.
2. COVERS SHALL BE STEEL.

NOT TO SCALE