

2018 AUG 14 A 11: 23

**ORDER FOR POLE LOCATION
CITY OF FRAMINGHAM**

WHEREAS, **NSTAR ELECTRIC COMPANY d/b/a EVERSOURCE ENERGY** has petitioned for permission to erect or construct a line of the transmission of electricity for lighting, heating or power upon, along and across the public way or ways of the City of Framingham, and notice has been given and a hearing held on said petition as provided by law.

By the City Council of the City of Framingham, Massachusetts notice having been given and a public hearing held, as provided by law, **IT IS HEREBY ORDERED:**

That **NSTAR ELECTRIC COMPANY d/b/a EVERSOURCE ENERGY** and hereby is granted permission to erect or construct, and a location for, such a line of wires, poles and other such fixtures including anchors and guy as may be necessary to sustain or protect the wires of the line upon, along and across the following public way or ways of the City of Framingham as requested in petition of said Company dated the 22nd day of October, 2018.

SUMMER STREET: Northwesterly side approximately ninety-four (94±) feet Southwest of Concord Street. Install one (1) guy stub pole 210/1-1X.

Reason: Work is necessary to provide additional support to pole 210/1 as the existing tree guy is being removed.

1 guy stub pole to be placed

Also for permission to lay and maintain underground laterals, cables and wires in the above or intersecting public ways for the purpose of making connections with such poles and buildings as said petitioner may desire for distributing purposes.

All construction under this order shall be in accordance with the following conditions:

- 1) Poles shall be of sound timber and located as shown on a plan made by A. Debenedictis dated October 02, 2018, on file with said petition.
- 2) There may be attached to said poles by **NSTAR ELECTRIC COMPANY d/b/a EVERSOURCE ENERGY** wires and cables necessary for the conduit of its business.
- 3) All such wires and cables shall be placed at a height of not less than eighteen (18) feet from the ground.

In addition, all construction shall comply with the following conditions set forth in a letter dated November 26, 2018 from the Framingham Department of Public Works as follows:

- 1) The proposed guy pole stub pole (new) shall be installed a minimum five feet away from City utilities. The Department of Public Works requests notification prior to the start of work to verify final location in the field.
- 2) All work shall conform to the City of Framingham construction standards.
- 3) The proposed work shall be inspected by the City of Framingham DPW to verify that no public utilities are adversely affected.
- 4) The area in the vicinity of the work shall be restored and all excess excavation resulting from pole setting shall be removed by the Grantee.


We hereby certify that the foregoing Order was adopted after due notice and a public hearing as prescribed by Section 22 of Chapter 166 of the General Laws (Ter. Ed.), and any additions thereto or amendments thereof, to wit: after written notice of the time and place of the hearing mailed at least seven days prior to the date of the hearing by the city Council to all owners of real estate abutting upon that part of the way or ways upon, along or across with the line is to be constructed under said Order, as determined by the last preceding assessment for taxation, and a public hearing held on the 18th day of December , 2018 at 7:00 PM at Memorial Hall, 150 Concord Street, Framingham Massachusetts.

City Council
City of Framingham, Massachusetts



CERTIFICATE

I hereby certify that the foregoing is a true copy of a location order and certificate of hearing with notice adopted by City Council of the City of Framingham, Massachusetts on the **18th day of December 2018** and recorded with the records of location Orders of said City, Book 16 Page 18-8 , and of the certificate of notice of hearing thereon required by Section 22 of chapter 166 of the General Laws (Ter. Ed.), and any additions to thereto or amendments thereof, as the same appear of record.

Attest:



Lisa A. Ferguson
City Clerk

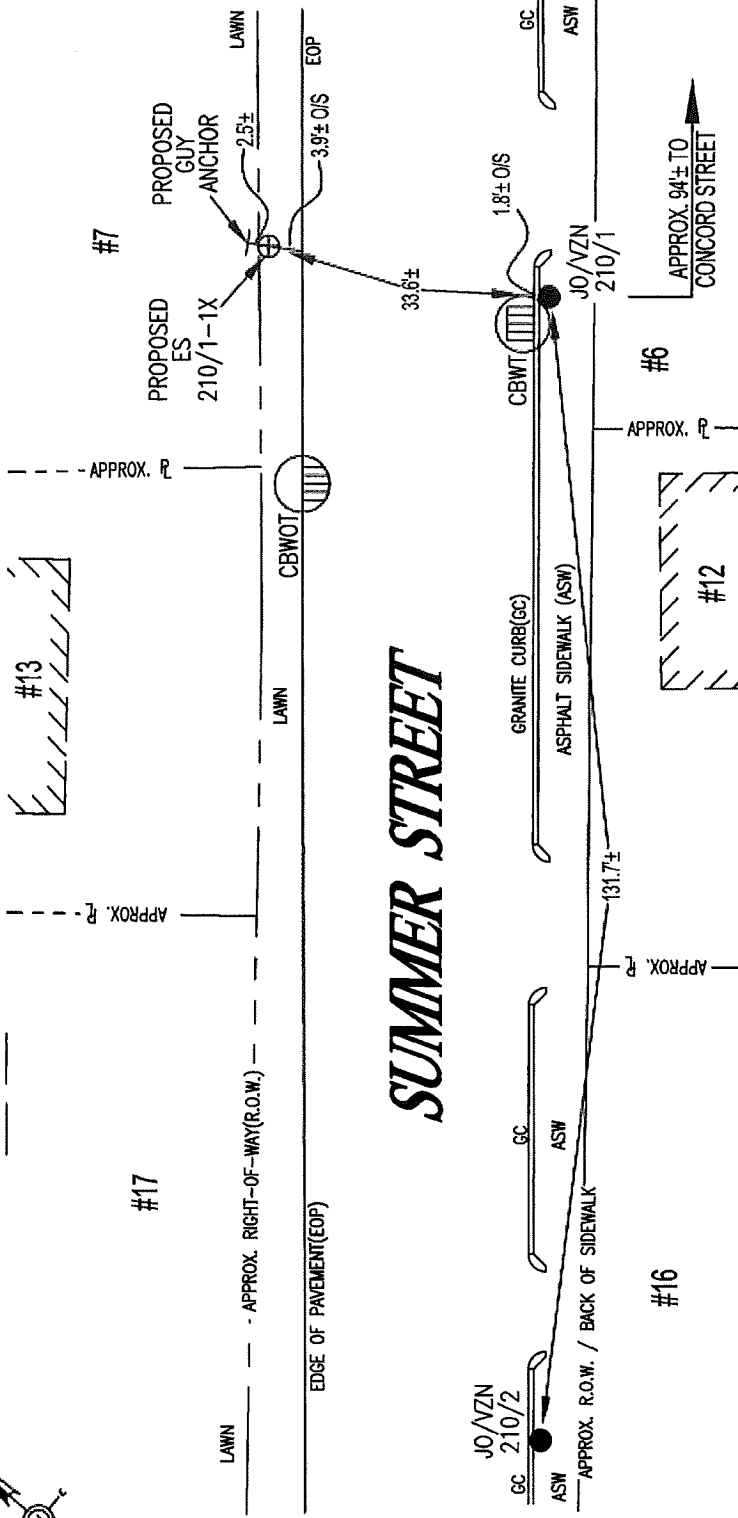


SUMMER STREET

PURPOSE: REMOVE EXISTING TREE GUY AND TO PROVIDE ADDITIONAL SUPPORT TO POLE 210/1.

BY YOUR USE OF THE INFORMATION CONTAINED IN THIS MAP, YOU AGREE THAT NO WARRANTY OF ANY KIND, EXPRESS OR IMPLIED, IS GIVEN WITH RESPECT TO THE INFORMATION. NEITHER INSTAR ELECTRIC COMPANY, INSTAR GAS COMPANY NOR ITS PARENTS, AFFILIATES, OFFICERS, DIRECTORS, SHAREHOLDERS, EMPLOYEES OR AGENTS (COLLECTIVELY THE "INSTAR ENTITIES") SHALL BE LIABLE FOR ANY DAMAGES, INCLUDING REASONABLE ATTORNEY'S FEES, ARISING FROM THIS INFORMATION, OR FROM ANY USE OF THIS INFORMATION, OR FROM ANY RELIANCE ON THIS INFORMATION, OR FROM ANY AGREEMENT BY YOUR ACCEPTANCE OF THE INFORMATION TO RELEASE, INDEMNIFY AND HOLD THE INSTAR ENTITIES HARMLESS FROM ANY SUCH LOSS OR INJURY.

THE INFORMATION MAY NOT REPRESENT A SURVEY, MAY NOT BE THE MOST COMPLETE AND IS SUBJECT TO CHANGE WITHOUT NOTICE. NO LIABILITY IS ASSUMED FOR THE ACCURACY OF THE INFORMATION, OR FOR ANY DAMAGES, INCLUDING REASONABLE ATTORNEY'S FEES, ARISING FROM THIS INFORMATION, OR FROM ANY RELIANCE ON THIS INFORMATION FOR OTHER THAN ITS INTENDED PURPOSES ARE PROHIBITED.



- Proposed pole locations shown thus ⊕
- Pole locations to be abandoned, shown thus ○
- Proposed Anchor Guy shown thus T
- Proposed Hip Guy shown thus T_H
- Proposed Underground location shown thus _____
- Proposed Push Brace shown thus ⊕
- Existing Pole location shown thus ●

INSTAR EVERSOURCE ELECTRIC G/D/B/A 1185 MASSACHUSETTS AVE. DORCHESTER, MASS. 02125	
Plan of	SUMMER STREET
Research by:	GC/BP
Plotted by:	PG
Proposed Structures:	GC
Showing	PROPOSED STUB POLE & GUY ANCHOR LOCATIONS
Scale	1"=20'
Date	OCTOBER 2, 2018
SHEET	1 of 1



CITY OF FRAMINGHAM
DEPARTMENT OF PUBLIC WORKS
FRAMINGHAM, MASSACHUSETTS 01702

*"Dedicated to
Excellence
in Public
Service"*

PETER A. SELLERS
EXECUTIVE DIRECTOR | FDPW
PAUL G. BARDEN
DEPUTY DIRECTOR | FDPW
WILLIAM R. SEDEWITZ - PE
CHIEF ENGINEER | FDPW
DIANE M. CONNER
ASSISTANT DIRECTOR | FDPW

November 26, 2018

City Council
City of Framingham
Memorial Building
150 Concord Street
Framingham, MA 01702

Re: Summer Street - Grant of Location Request – NSTAR W.O. #228088

Dear City Council,

The Department of Public Works (the Department) is in receipt of a request from NSTAR Electric Company d/b/a as EVERSOURCE ENERGY to install new pole, wire, cables and fixtures, including the necessary anchors, guys and other such sustaining and protecting fixtures to be owned and used in common by your petitioners, along and across the following public way or ways of Summer Street in support of installing one guy stub pole number 210/1 (existing tree guy being removed), all as represented under submitted Grant of Location application package, reference NSTAR W.O. #228088.

We have reviewed this Grant of Location request submitted to the City Council and recommend approval subject to the following conditions:

1. The proposed guy pole stub pole (new) shall be installed a minimum five feet away from City utilities. The Department requests notification prior to the start of work to verify final location in the field.
2. All work shall conform to the City of Framingham construction standards.
3. The proposed work shall be inspected by the City of Framingham DPW to verify that no public utilities are adversely affected.
4. The area in the vicinity of the work shall be restored and all excess excavation resulting from pole setting shall be removed by the Grantee.

Please contact me at (508) 532-6010 if you have any questions.

Yours very truly,

Eric V. Johnson, P.E.
City Engineer

CC: Peter Sellers, Executive Director FDPW
William R. Sedewitz, P.E., Chief Engineer

Dan Nau, Highway & Sanitation Director
Jeanette Galliardt, Executive Asst.